

JOB:

LOCATION:

ARCHITECT:




MECH ENG:

CONTRACTOR:

DATE:

CTQ/CPT

Heating and Cooling Control Package

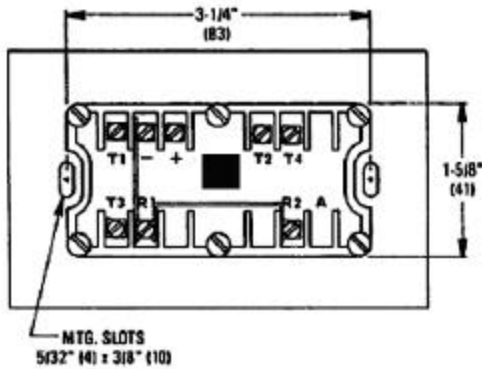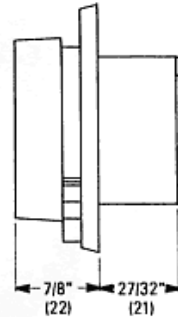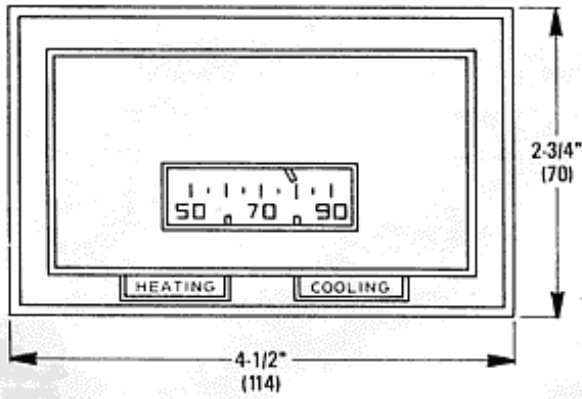

___CTQ 18 ft. Master cable

___CPT 16 ft. Slave cable

Application

Standard cable - 18ft. CTQ/16ft. CPT for heating and cooling.

On the back of the thermostat a female receptacle is mounted. Both ends of the thermostat cable (CTQ) contain male phone jack plugs-one to fit into the back of the thermostat and the other into the control box mounted on the unit labeled "Master". No wiring of the thermostat is necessary.

The white slave cable has two plastic connectors-one on each end. One goes into the master control box labeled "slave" and the other end snaps into the slave unit.